# DAC007/107 29 JANUARY 2007




# SmartMod <u>Analog Output Module</u>

HE359DAC007 / HE359DAC107 Selectable 0-20mA or 0-10V 14-Bit Resolution




# 1 SPECIFICATIONS


	DAC007	DAC107			DAC007	DAC107
Number of Channels	2	4	-	Auxiliary Voltage	12V @ 20mA (4 channels)	
Output Ranges	0-20	0-20mA or 0-10V		Terminal Type	Screw Type, Removable	
Resolution	Appro	pproximately 14-Bit		Storage Temp.	-40° to 85° Celsius	
Voltage: >5Kohm			Operating Temp.	-10° to 60°	Celsius	
Load Resistance	Curr	Current: <500ohm		Relative Humidity	5 to 95% Non-condensing	
Output Calibration		Voltage: +/-10mV Current: +/-20uA		Dimensions WxHxD	17.5mm x 100mm x 120mn 0.69" x 3.94" x 4.72"	
External Power Supply Voltage		10-30Vdc		Weight	150g (6 oz.)	
Required Power (Steady State)		mA @ 24Vdc, typical (100mA max)		Communications	Modbus/RTI RS-485 ha	
Required Power (Inrush)		Negligible		Default Comms. Parameters	38400 baud, N Default Mod	
Isolation		00Vac for 60 seconds /Power & Input/Comms)		Supported Modbus Commands (family)	1,2,3,4,5,6	,8,15,16
CE & UL Compliance See Compliance Tab			able	ble at http://www.heapg.com/Support/compliance.htm		

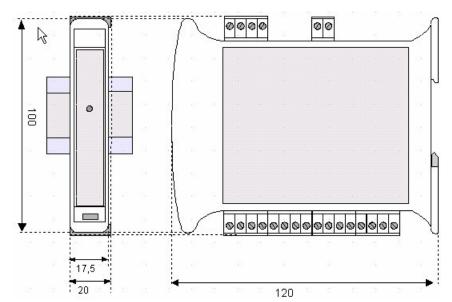

Dimensions in inches are 0.69"W x 3.95"H x 4.72"D Note: Number of I/O terminal connections vary from model to model


### 2 WIRING - I/O

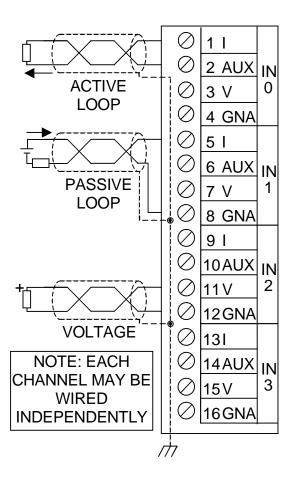




Pin#	DAC007	DAC107	
1	I	I	
2	AUX	AUX	OUT 0
3	V	V	0010
4	GNA	GNA	
5	I	I	
6	AUX	AUX	OUT 1
7	V	V	0011
8	GNA	GNA	
9		l	
10		AUX	OUT 2
11	Only Terminals	V	0012
12	1 through 8 are	GNA	
13	present on the	I	
14	DAC007 model	AUX	OUT 2
15		V	OUT 3
16		GNA	

# **WIRING - RS-485**



# WIRING - DC IN



#### Notes:

Both ends of the RS-485 network should be terminated with a 100ohm, 1/4W, 1% resistor. Many OCS controllers feature dip switches or jumpers which enable appropriate termination if the OCS is located on a network end..

When the INIT terminal is shorted to GND, factory default parameters are loaded into the module (RTU mode, 38.4kbaud, N, 8, 1 with Modbus ID 1)

#### 3 CONFIGURATION DATA

SmartMod Configuration settings are mapped into Modbus Register space. This configuration data may be modified with any Modbus/RTU Master device. For convenience, Horner APG has developed a variety of Cscape application files which allow an OCS (Xle, NX, LX, QX) to act as a SmartMod configurator. Initial configuration of SmartMod module should be done on an individual basis, since all modules come from the factory with a default Modbus ID of 1. Once each module on the network has its own unique Modbus ID, further configuration adjustments can be made with the entire network powered.

All configuration parameters listed below (except 40012 Channel Enable) are stored in EPROM. That means they should not be constantly rewritten.

Configuration Parameters – Registers 40001 through 40013					
Modbus Register	Description	Min	Max	Default	
40001-40005	Reserved				
40006	Communications Parameters	See T	able	38.4kbaud, N, 8, 1, RTU Mode	
40007	Modbus ID	1	255	1	
40008	Rx/Tx Delay (in 2mS steps)	0	255	0mS	
40009	Watchdog Timer (in 0.5s steps)	0	255	10 (5s)	
40010	Modbus Coil Data	Modbus Coil Data Not Configuration Data – See I/O Data			
40011	Reserved				
40012	Reserved				
40013	Reserved				
40014	Output Type	See Table 0 (All Channels Current		0 (All Channels Current)	

Register 40006 (Communications Parameters) Bit Definition								
Bits 7-15	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0	
Unused	Mode	Pa	rity	Data Bits	Baud Rate			
	0 = ASCII	Value	Meaning	0 = 7 Data Bits	Value	Meaning		
	Mode	0	Mark		0	1200	baud	
	Widde	1	Even		1	2400 baud		
	1 = RTU Mode	2	Odd	1 = 8 Data	2	4800	baud	
		3	Space		Bits	3	9600	baud
				DIIS	4	19200	) baud	
					5-7	38400	) baud	

Register 40014 (Output Type) Bit Definition						
Bit 4-15 Bit 3 Bit 2 Bit 1 Bit 0						
	Output 3	Output 2	Output 1	Output 0		
Unused	0 = Current (0-20mA)					
		1 = Voltag	ge (0-10V)			

#### DAC007/107 29 JANUARY 2007

#### 4 INPUT / OUTPUT DATA

SmartMod Analog I/O utilizes both Modbus Registers (40001-40030) and Coils (1-11). It is possible to access all data using Registers only, because the Coils can be accessed through Register 40010.

The following tables lists all Modbus I/O data available.

I/O Register Data (Registers 40010-40026)						
Modbus						
Register	Description	Access	Minimum	Maximum	Units	
40010	Mirror of Coil Data	Read/Write	n/a	n/a	n/a	
40015	Output 0	Read/Write	0	20000	1uA or 1mV	
40016	Output 1	Read/Write	0	20000	1uA or 1mV	
40017	Output 2	Read/Write	0	20000	1uA or 1mV	
40018	Output 3	Read/Write	0	20000	1uA or 1mV	
40019-40022	Reserved					
40023	Default/Safe Value Out 0	Read/Write	0	20000	1uA or 1mV	
40024	Default/Safe Value Out 1	Read/Write	0	20000	1uA or 1mV	
40025	Default/Safe Value Out 2	Read/Write	0	20000	1uA or 1mV	
40026	Default/Safe Value Out 3	Read/Write	0	20000	1uA or 1mV	

Modbus Coil	Description	Access
00009	Watchdog Enabled	Read/Write
00010	Watchdog Event	Read/Write
00011	Power-up Event	Read/Write

Modbus Register	Description	Access	
40010 bit 0	40010 bit 0 Watchdog Enabled		
40010 bit 1	Watchdog Event	Read/Write	
40010 bit 2	Power-up Event	Read/Write	

# Watchdog Event & Power-up Event Operation

If Coil 9 (Watchdog Enabled) is set, Coil 10 (Watchdog Event) will set if the Watchdog Timeout value is exceeded. The Watchdog Timeout value is set in Register 40009. When set, Coil 10 can be reset by the controller when normal communications resumes.

The Power-up Event (Coil 11) is set every time the power is applied. It can be cleared by the controller if desired.

#### 5 INSTALLATION / SAFETY

**Warning:** Remove power from the OCS controller, CAN port, and any peripheral equipment connected to this local system before adding or replacing this or any module.

- a. All applicable codes and standards should be followed in the installation of this product.
- b. Shielded, twisted-pair wiring should be used for best performance.
- c. Shields may be terminated at the module terminal strip.
- d. In severe applications, shields should be tied directly to the ground block within the panel.
- e. Use the following wire type or equivalent: Belden 8441.

For detailed installation and a <u>handy checklist</u> that covers panel box layout requirements and minimum clearances, refer to the hardware manual of the controller you are using. (See the **Additional References** section in this document.)

When found on the product, the following symbols specify:



Warning: Consult user documentation.



Warning: Electrical Shock Hazard.

# DAC007/107 29 JANUARY 2007

# **6 TECHNICAL SUPPORT**

For assistance and manual up-dates, contact Technical Support at the following locations:

Helpdesk: http://www.horner-apg.com/helpdesk

North America: Europe:

(317) 916-4274 (+) 353-21-4321-266 <u>www.heapg.com</u> <u>www.horner-apg.com</u> **NOTES**