

Digital Outputs

24 VDC Out, Positive Logic

Smart tackm

HE800DQM306 (16 Outputs) / HE-DQM306* (16 Outputs)

HE800DQM406 (32 Outputs) / HE-DQM406* (32 Outputs)

* HE- denotes plastic case.


1 SPECIFICATIONS

OUTPUT	DQM306	DQM406			DQM306	DQM406
Outputs per Module	16	32	-	Maximum Inrush Current per channel	650	mA
Power Commons per Module	1	2		Minimum Load	No	one
Operating Voltage	10-30 VDC		1	OFF to ON Response	1 r	ns.
Output Type	Sourcing / 10 K PullDown			ON to OFF Response	1 r	ns.
Peak Voltage	28 VDC Max.			Output Characteristics	Current Sourcing	
Maximum Load Current per channel	0.5 A Max. per output		_	Output Protection	Short	Circuit


General Specifications			
Required Power (Steady State)	0.12 W (5 mA @ 24 VDC)	Operating Temperature	0°–60° Celsius
Required Power (Inrush)	Negligible	Terminal Type	Spring Clamp, Removable
Relative Humidity	5–95% Noncondensing	Weight	9 oz. (256 g)
CE UL	See Compliance Table at htt	p://www.heapg.com/	Support/compliance.htm

2 WIRING

2.1 Bottom Connector (Used by DQM306 and DQM406)

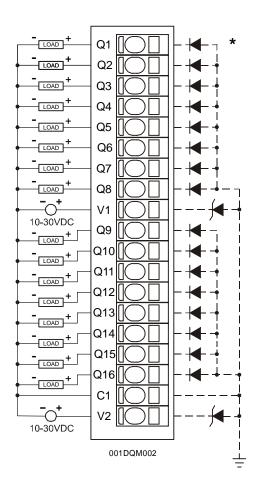

Note: For Class I, Div. 2 operation, V1, V2, V3, and V4 must share the same power supply.




Corresponding I/O Pin


	Signal
Pin	DQM306/406
	OUTPUT
Q1	Output 1
Q2	Output 2
Q3	Output 3
Q4	Output 4
Q5	Output 5
Q6	Output 6
Q7	Output 7
Q8	Output 8
V1	Load Power 1
Q9	Output 9
Q10	Output 10
Q11	Output 11
Q12	Output 12
Q13	Output 13
Q14	Output 14
Q15	Output 15
Q16	Output 16
C1	Common 1
V2	Load Power 2

Load Power	Outputs
1	1-8
2	9-16

2.2 Top Connector (Used by DQM406 only)

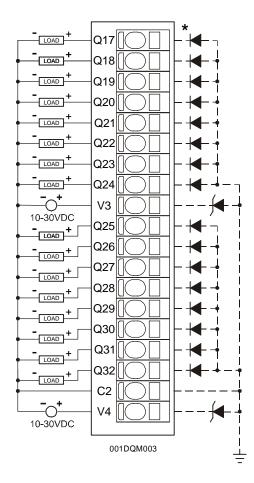


Note: For Class I, Div. 2 operation, V1, V2, V3, and V4 must share the same power supply.



	Signal
Pin	DQM406
	OUTPUT
Q17	Output 17
Q18	Output 18
Q19	Output 19
Q20	Output 20
Q21	Output 21
Q22	Output 22
Q23	Output 23
Q24	Output 24
V3	Load Power 3
Q25	Output 25
Q26	Output 26
Q27	Output 27
Q28	Output 28
Q29	Output 29
Q30	Output 30
Q31	Output 31
Q32	Output 32
C2	Common 1
V4	Load Power 4

Load Power	Outputs
3	17-24
4	25-32

3 INTERNAL WIRING

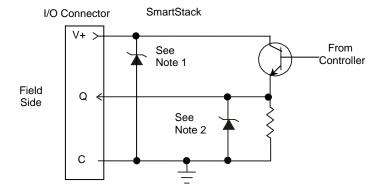

Note 1: Specification for transient voltage suppressors (transorbs) used on output circuitry is 36 V, 300 W.

Note 2: Specification for transient voltage suppressors (transorbs) used on output circuitry is 33 V, 300 W.

4 **CONFIGURATION**

Note: The status of the I/O can be monitored in Cscape Software.

Preliminary configuration procedures that apply to SmartStack[™] Modules are contained in the hardware manual of the controller you are using. Refer to the <u>Additional References</u> section in this data sheet for a listing of hardware manuals.

Selecting the **I/O Map** tab provides information about the I/O registers, which are assigned to a specific SmartStack[™] Module and where the module is located in the point map. The I/O Map is determined by the model number and location within the SmartStack[™]. The I/O Map is <u>not</u> edited by the user.

The **Module Setup** is used in applications where it is necessary to change the default states of the outputs when the controller (e.g., OCS100) enters idle/stop mode. The default turns the outputs OFF when the controller enters idle/stop mode. By selecting the Module Setup tab, each output can be set to either turn ON, turn OFF or to hold the last state. Generally, most applications use the default settings.

Warning: The default turns the outputs OFF when the controller enters idle/stop mode. To avoid injury of personnel or damages to equipment, exercise extreme caution when changing the default setting using the **Module Setup** tab.

5 INSTALLATION / SAFETY

Warning: Remove power from the OCS controller, CAN port, and any peripheral equipment connected to this local system before adding or replacing this or any module.

Use the following wire type or equivalent:

- Belden 8917
- 16 AWG or larger

For detailed installation and a <u>handy checklist</u> that covers panel box layout requirements and minimum clearances, refer to the hardware manual of the controller you are using. (See the <u>Additional References</u> section in this document.).

When found on the product, the following symbols specify:



Warning: Consult user documentation.



Warning: Electrical Shock Hazard.

WARNING: To avoid the risk of electric shock or burns, always connect the safety (or earth) ground before making any other connections.

WARNING: To reduce the risk of fire, electrical shock, or physical injury it is strongly recommended to fuse the voltage measurement inputs. Be sure to locate fuses as close to the source as possible.

WARNING: Replace fuse with the same type and rating to provide protection against risk of fire and shock hazards.

WARNING: In the event of repeated failure, do <u>not</u> replace the fuse again as a repeated failure indicates a defective condition that will <u>not</u> clear by replacing the fuse.

WARNING: Only qualified electrical personnel familiar with the construction and operation of this equipment and the hazards involved should install, adjust, operate, or service this equipment. Read and understand this manual and other applicable manuals in their entirety before proceeding. Failure to observe this precaution could result in severe bodily injury or loss of life.

For detailed installation and a <u>handy checklist</u> that covers panel box layout requirements and minimum clearances, refer to the hardware manual of the controller you are using. (See the <u>Additional References</u> section in this document.):

- All applicable codes and standards need to be followed in the installation of this product.
- For I/O wiring (discrete), use the following wire type or equivalent: Belden 9918, 18 AWG or larger.

Adhere to the following safety precautions whenever any type of connection is made to the module.

- Connect the green safety (earth) ground first before making any other connections.
- When connecting to electric circuits or pulse-initiating equipment, open their related breakers. Do <u>not</u> make connections to live power lines.
- Make connections to the module first; then connect to the circuit to be monitored.
- Route power wires in a safe manner in accordance with good practice and local codes.
- Wear proper personal protective equipment including safety glasses and insulated gloves when making connections to power circuits.
- Ensure hands, shoes, and floor are dry before making any connection to a power line.
- Make sure the unit is turned OFF before making connection to terminals. Make sure all circuits are de-energized before making connections.
- Before each use, inspect all cables for breaks or cracks in the insulation. Replace immediately if defective.

6 ADDITIONAL REFERENCES

The following information serves as a *general* listing of Horner controller products and other references of interest and their corresponding manual numbers. Visit our website listed in the <u>Technical Support</u> section to obtain user documentation and updates.

Note: This list is <u>not</u> intended for users to determine which products are appropriate for their application; controller products differ in the features that they support. If assistance is required, see the **Technical Support** section in this document.

Controller	Manual Number		
XLE Series (e.g., HE-XExxx)	MAN0805		
QX Series (e.g., HE-QXxxx)	MAN0798		
NX Series (e.g., HE-NXxxx)	MAN0781		
LX Series (e.g., LX-xxx; also covers RCS116)	MAN0755		
Color Touch OCS (e.g., OCSxxx)	MAN0465		
OCS (Operator Control Station) (e.g., OCS1xx / 2xx; Graphic OCS250)	MAN0227		
Remote Control Station (e.g., RCS2x0)			
MiniOCS (e.g., HE500OCSxxx, HE500RCSxxx)	MAN0305		
Other Useful References			
CAN Networks	MAN0799		
Cscape Programming and Reference	MAN0313		
Wiring Accessories and Spare Parts Manual	MAN0347		
DeviceNet [™] Implementation	SUP0326		
Wiring Accessories and Spare Parts Manual	MAN0347		

7 TECHNICAL SUPPORT

For assistance and manual up-dates, contact Technical Support at the following locations:

North America:+	Europe:
(317) 916-4274	(+) 353-21-4321-266
www.heapg.com	www.horner-apg.com