29 JANUARY 2007




SmartMod Analog Output Module

HE359DAC201 0-10V 14-Bit Resolution




SPECIFICATIONS 1


		DAC201			DAC201	
Number of Channels		8	Therm		100ppm max	
Output Ranges		0-10V		Terminal Type	Screw Type, Removable	
Resolution	А	pproximately 14-Bit	-	Storage Temp.	-40° to 85° Celsius	
Load Resistance	Voltage: >5Kohm			Operating Temp.	-10° to 60° Celsius	
Load Resistance				Relative Humidity	5 to 95% Non-condensing	
Output Calibration		Voltage: +/-10mV		Dimensions WxHxD	17.5mm x 100mm x 120mm 0.69" x 3.94" x 4.72"	
External Power Supply Voltage		18-30Vdc		Weight	150g (6 oz.)	
Required Power (Steady State)	30	30mA @ 24Vdc, typical		Communications	Modbus/RTU (binary) RS-485 half duplex	
Required Power (Inrush)	Negligible			Default Comms. Parameters	38400 baud, N, 8, 1, no h/s Default Modbus ID 1	
Isolation		000Vac for 60 seconds ut/Power & Input/Comms)		Supported Modbus Commands (family)	1,2,3,4,5,6,8,15,16	
CE & UL Compliance See Compliance		See Compliance Tal	ole at http://www.heapg.com/Support/compliance.htm			

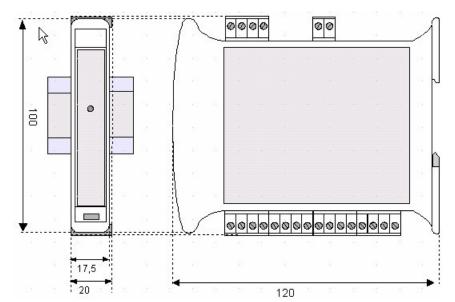

Dimensions in inches are 0.69"W x 3.95"H x 4.72"D Note: Number of I/O terminal connections vary from model to model


2 WIRING - I/O

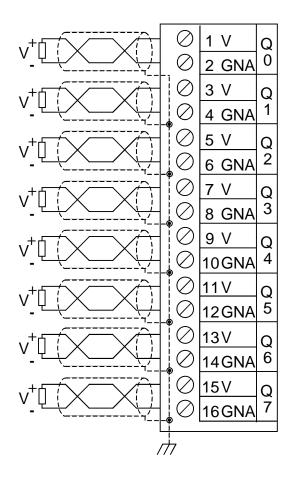




Pin#	DAC201		
1	V	OUT 0	
2	GNA		
3	V	OUT 1	
4	GNA	0011	
5	V	OUT 2	
6	GNA	0012	
7	V	OUT 2	
8	GNA	OUT 3	
9	V	OUT 4	
10	GNA	OUT 4	
11	V	OUT 5	
12	GNA	OUT 5	
13	V	OUT 6	
14	GNA	OUT 6	
15	V	OUT 7	
16	GNA	OUT 7	

WIRING - RS-485



WIRING - DC IN



Notes:

Both ends of the RS-485 network should be terminated with a 100ohm, 1/4W, 1% resistor. Many OCS controllers feature dip switches or jumpers which enable appropriate termination if the OCS is located on a network end..

When the INIT terminal is shorted to GND, factory default parameters are loaded into the module (RTU mode, 38.4kbaud, N, 8, 1 with Modbus ID 1)

<u>DAC201</u> 29 JANUARY 2007

3 CONFIGURATION DATA

SmartMod Configuration settings are mapped into Modbus Register space. This configuration data may be modified with any Modbus/RTU Master device. For convenience, Horner APG has developed a variety of Cscape application files which allow an OCS (XIe, NX, LX, QX) to act as a SmartMod configurator. Initial configuration of SmartMod module should be done on an individual basis, since all modules come from the factory with a default Modbus ID of 1. Once each module on the network has its own unique Modbus ID, further configuration adjustments can be made with the entire network powered.

All configuration parameters listed below (except 40012 Channel Enable) are stored in EPROM. That means they should not be constantly rewritten.

Configuration Parameters – Registers 40001 through 40013					
Modbus Register	Description	Min	Max	Default	
40001-40005	Reserved				
40006	Communications Parameters	See	Table	38.4kbaud, N, 8, 1, RTU Mode	
40007	Modbus ID	1	255	1	
40008	Rx/Tx Delay (in 2mS steps)	0	255	0mS	
40009	Watchdog Timer (in 0.5s steps)	0	255	10 (5s)	
40010	Modbus Coil Data	Modbus Coil Data Not Configuration Data – See I/O Data			
40011	Reserved				
40012	Reserved				
40013	Reserved				
40014	Output Type 255 255 (All channels Voltage)				

Register 40006 (Communications Parameters) Bit Definition							
Bits 7-15	Bit 6	Bit 5	Bit 4	Bit 3	Bit 2	Bit 1	Bit 0
Unused	Mode	Pa	rity	Data Bits	Baud Rate		
	0 = ASCII Mode	Value	Meaning	0 = 7 Data Bits	Value	Meaning	
		0	Mark		1 0 1 1200 ha		baud
		1	Even		1	2400	baud
	4 DTU	2	Odd	1 = 8 Data Bits	2	4800	baud
Mod	1 = RTU Mode	3	Space		3	9600 baud	
	Mode			Dits	4	19200	baud
					5-7	38400	baud

DAC201 29 JANUARY 2007

4 INPUT / OUTPUT DATA

SmartMod Analog I/O utilizes both Modbus Registers (40001-40030) and Coils (1-11). It is possible to access all data using Registers only, because the Coils can be accessed through Register 40010.

The following tables lists all Modbus I/O data available.

I/O Register Data (Registers 40010-40026)						
Modbus						
Register	Description	Access	Minimum	Maximum	Units	
40010	Mirror of Coil Data	Read/Write	n/a	n/a	n/a	
40015	Output 0	Read/Write	0	10000	1mV	
40016	Output 1	Read/Write	0	10000	1mV	
40017	Output 2	Read/Write	0	10000	1mV	
40018	Output 3	Read/Write	0	10000	1mV	
40019	Output 4	Read/Write	0	10000	1mV	
40020	Output 5	Read/Write	0	10000	1mV	
40021	Output 6	Read/Write	0	10000	1mV	
40022	Output 7	Read/Write	0	10000	1mV	
40023	Default/Safe Value Out 0	Read/Write	0	10000	1mV	
40024	Default/Safe Value Out 1	Read/Write	0	10000	1mV	
40025	Default/Safe Value Out 2	Read/Write	0	10000	1mV	
40026	Default/Safe Value Out 3	Read/Write	0	10000	1mV	
40027	Default/Safe Value Out 4	Read/Write	0	10000	1mV	
40028	Default/Safe Value Out 5	Read/Write	0	10000	1mV	
40029	Default/Safe Value Out 6	Read/Write	0	10000	1mV	
40030	Default/Safe Value Out 7	Read/Write	0	10000	1mV	

Modbus		
Coil	Description	Access
00009	Watchdog Enabled	Read/Write
00010	Watchdog Event	Read/Write
00011	Power-up Event	Read/Write

Modbus Register	Description	Access
40010 bit 0	Watchdog Enabled	Read/Write
40010 bit 1	Watchdog Event	Read/Write
40010 bit 2	Power-up Event	Read/Write

Watchdog Event & Power-up Event Operation

If Coil 9 (Watchdog Enabled) is set, Coil 10 (Watchdog Event) will set if the Watchdog Timeout value is exceeded. The Watchdog Timeout value is set in Register 40009. When set, Coil 10 can be reset by the controller when normal communications resumes.

The Power-up Event (Coil 11) is set every time the power is applied. It can be cleared by the controller if desired.

5 INSTALLATION / SAFETY

Warning: Remove power from the OCS controller, CAN port, and any peripheral equipment connected to this local system before adding or replacing this or any module.

- a. All applicable codes and standards should be followed in the installation of this product.
- b. Shielded, twisted-pair wiring should be used for best performance.
- c. Shields may be terminated at the module terminal strip.
- d. In severe applications, shields should be tied directly to the ground block within the panel.
- e. Use the following wire type or equivalent: Belden 8441.

DAC201 29 JANUARY 2007

For detailed installation and a <u>handy checklist</u> that covers panel box layout requirements and minimum clearances, refer to the hardware manual of the controller you are using. (See the **Additional References** section in this document.)

When found on the product, the following symbols specify:



Warning: Consult user documentation.



Warning: Electrical Shock Hazard.

6 TECHNICAL SUPPORT

Helpdesk: http://www.horner-apg.com/helpdesk

For assistance and manual up-dates, contact Technical Support at the following locations:

North America:

(317) 916-4274 www.heapg.com Europe:

(+) 353-21-4321-266 www.horner-apg.com **NOTES**