MAN0938-01-EN Specifications / Installation



# **SmartRail**


# Thermocouple Input Module (Type J, K, T, R)

## HE599THM100 0.1°C Resolution, typical

#### 1 Specifications

Specifications				
•			THM100	
Number of Channels			4	
Types Supported			J, K, T, R	
Temperature Range		J	-200 to +1200 °C	
		K	-200 to +1300 °C	
		Т	-200 to +400 °C	
		R	0 to +1700 °C	
Resolution		J,K,T	0.1°C	
		R	0.5°C	
	Full-scale		±0.2% full scale @ 25°C	
Accuracy	Cold-Junction		±1°C	
	Temp. Coefficient		±100ppm/°C CJ (0-55°C)	
Warm-up Time			15 minutes	
Input Impedance			>10MΩ	
Isolation			500V (backplane)	
Dielectric Withstand			400Vac for 1 min (ch-ch)	
Conversion Time			50mS/ch	
Backplane Power Consumed			100mA @ 5V	
External Power Required			100mA @ 24V (+/-10%)	
	rminal Typ		Screw Type, Removable 11-posn	
Sto	rage Tem	p.	-25° to 70° Celsius	
Operating Temp.			-0° to 55° Celsius	
Relative Humidity			5 to 95% Non-condensing	
Dimensions WxHxD			20mm x 90mm x 60mm 0.79" x 3.54" x 2.36"	
Weight			63g (2.2 oz.)	
CE & UL Compliance		ance	CE, UL & C-ÚL	

### 2 Wiring – I/O

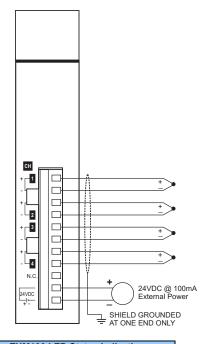

THM100 LED Status Indication			
LED	Meaning		
RUN	ON = Normal Operation		
	FLASH = I/O Error		
	OFF = No Power or I/O Error		
ALARM	OFF = Normal Operation		
	FLASH = Open Circuit Detected		

## Reported Data & Configuration Data

Data is reported to the OCS in signed integer format, with a single implied decimal place. For a temperature of +762.4°C, with a data range configured for °C, the reported data value is 7624 decimal. For a temperature of -12.1°F, with a data range configured for °F, the reported data value is -121 decimal.

The SmartRail THM100 is configured using Cscape (9.1 or later). The following parameters are configurable for the THM100:

Cscape Configuration Data – Selectable per channel			
Parameter	Selections		
Channel Enable	Enable		
Chamilei Lhable	Disable		
	K		
Thermocouple Type	J		
Thermocouple Type	Т		
	R		
Data Range	°C		
Data Range	°F		

#### 4 Installation / safety


**Warning:** Remove power from the OCS controller and any peripheral equipment connected to this local system before adding or replacing this or any module.

- a. All applicable codes and standards should be followed in the installation of this product.
- b. Shielded, thermocouple extension wiring of the proper type should be used for best performance.
- c. Shields should be terminated at one end only, at the end providing the best noise shunting.

For detailed installation and a <u>handy checklist</u> that covers panel box layout requirements and minimum clearances, refer to the hardware manual of the controller you are using.

When found on the product, the following symbols specify:





#### 7 Technical Support

Technical Support at the following locations:

North America: Europe:

Tel: 317 916-4274 Tel: +353-21-4321266 Fax: 317 639-4279 Fax: +353-21-4321826

Web: <a href="http://www.heapg.com">http://www.heapg.com</a> Web: <a href="http://www.horner-apg.com">http://www.horner-apg.com</a> Email: <a href="http://www.horner-apg.com">tech.support@horner-apg.com</a>

No part of this publication may be reproduced without the prior agreement and written permission of Horner APG, Inc. Information in this document is subject to change without notice.

3/23/2010 Page 1 of 1